


STANDARD OPERATION PROCEDURE

-Reboot Controller SMART Data Logger (GSN8-HV)

Front View



Bottom View

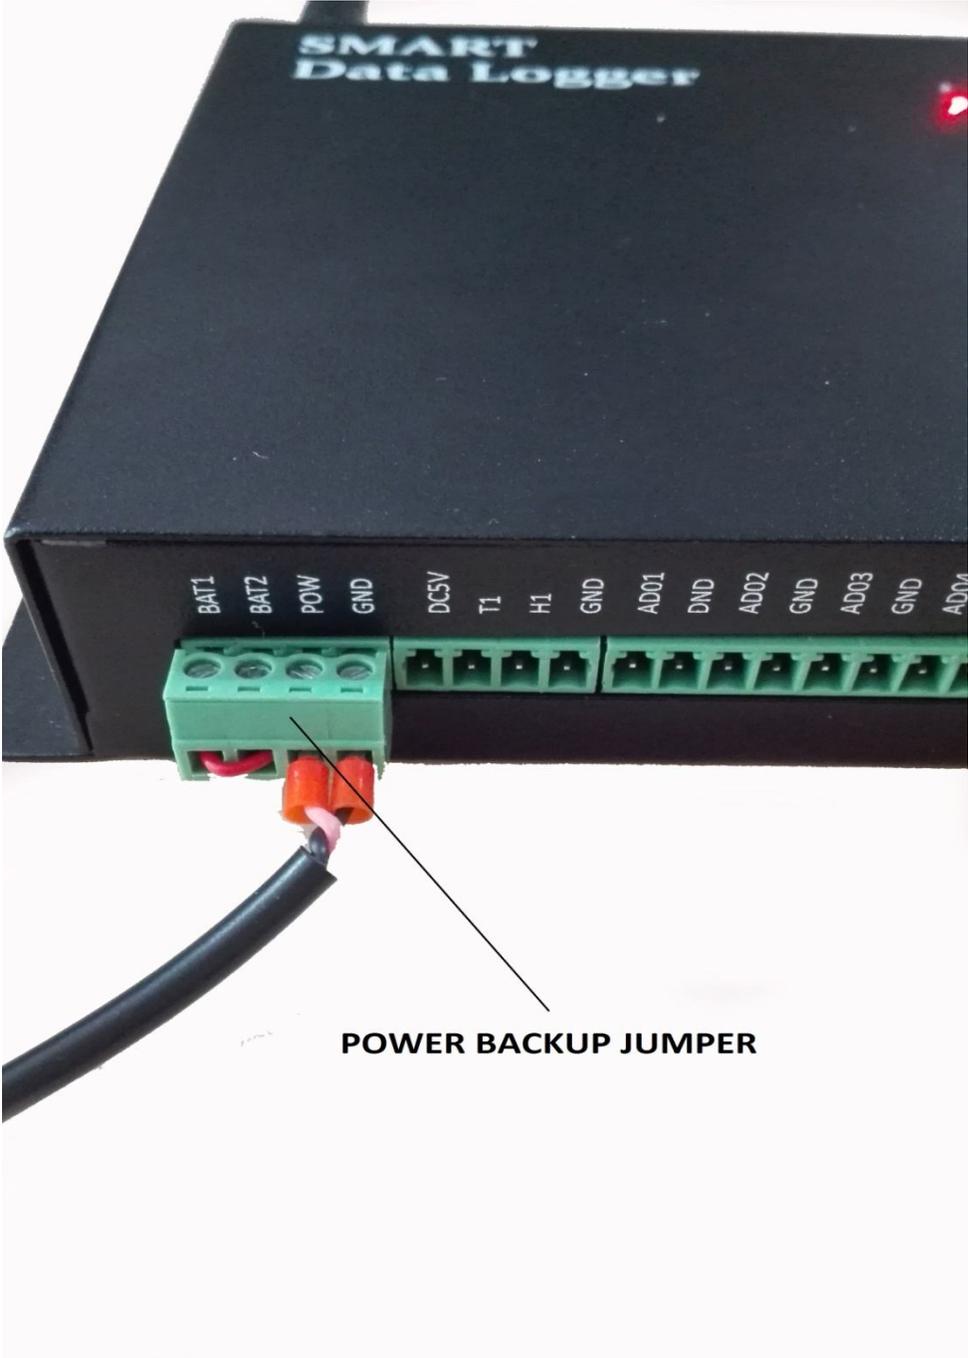

STEP BY STEP TO REBOOT THE CONTROLLER

1. Pull out the power backup jumper
2. Wait for 2 to 5 minutes
3. Slot in back the power backup jumper